



Designación	CCM
Tenant	STANDARD
Esquema de co.	ACOMETIDA BAJA TENSIÓN
Un (V)	TT
Un (V)	400 V
Ib (A)	27.3 A

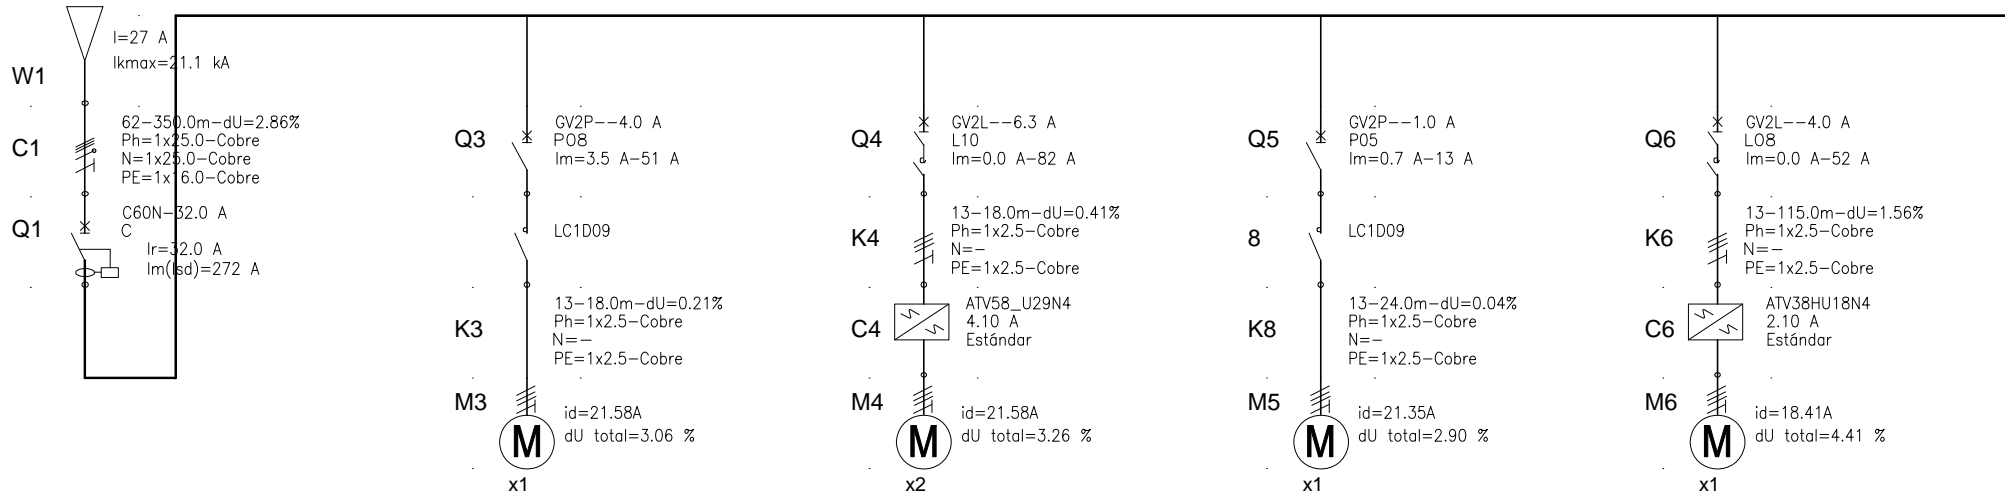

	ACOMETIDA BA W1-C1-Q1	BOMB AGUA BR Q3-K3-M3	BOMB AGUA BR Q4-K4-C4-M4	TAMIZ ROTATI Q5-K8-8-M5	BOMB RECIRC Q6-K6-C6-M6
Metal cond. de Fase	Cobre	Cobre	Cobre	Cobre	Cobre
Metal de cond. de PE	Cobre	Cobre	Cobre	Cobre	Cobre
Metal cond. de neutro	Cobre	Cobre	Cobre	Cobre	Cobre
Ib (A)		3.47	3.47	0.68	2.00
Potencia (kW)		1.92	2.40	0.31	1.04

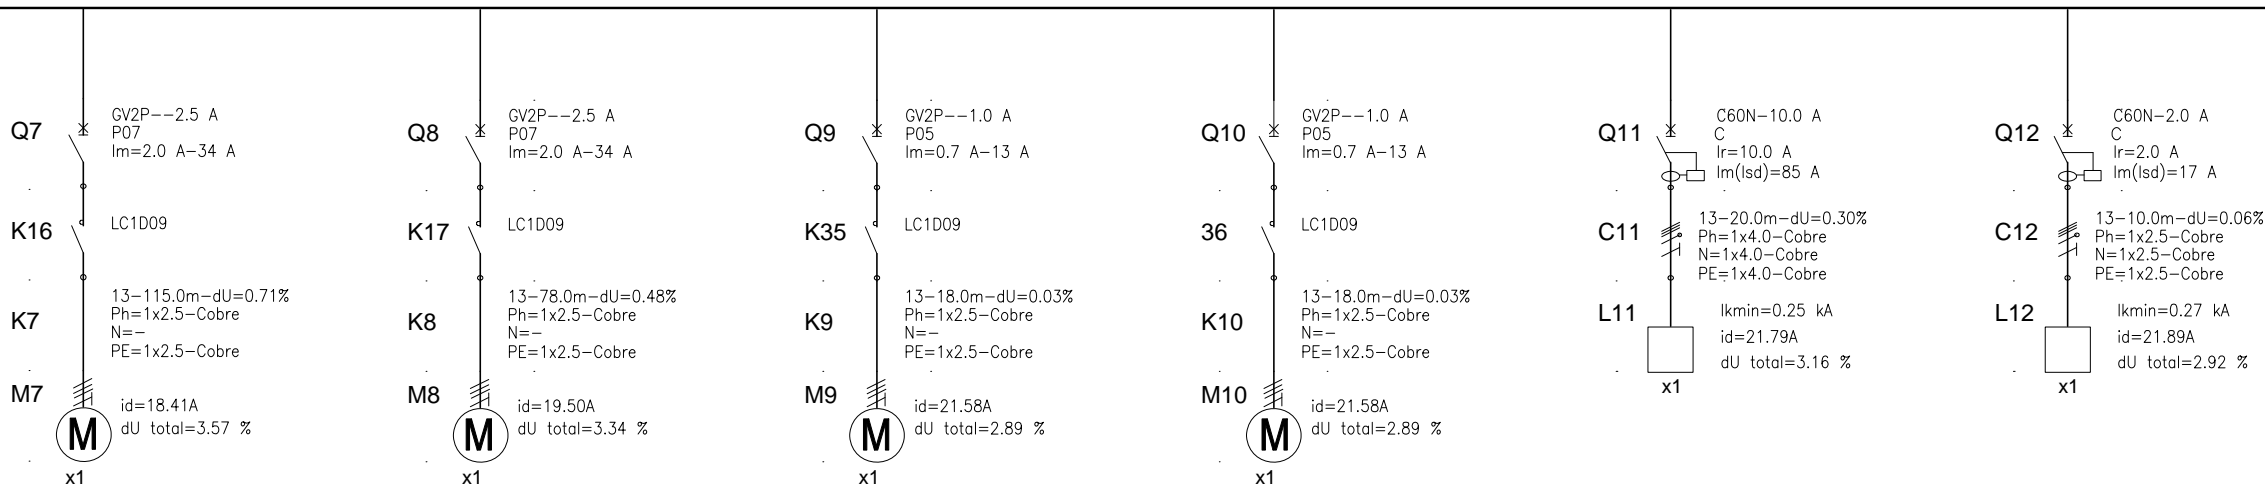

	BOMB RECIRC Q7-K7-K16-M7	BOMB DRENAJE Q8-K8-K17-M8	VENTILADOR S Q9-K9-K35-M9	VENTILADOR S Q10-K10-36-M	CUADRO ALUMB Q11-C11-L11	PLC Q12-C12-L12
Metal cond. de Fase	Cobre	Cobre	Cobre	Cobre	Cobre	Cobre
Metal de cond. de PE	Cobre	Cobre	Cobre	Cobre	Cobre	Cobre
Metal cond. de neutro	Cobre	Cobre	Cobre	Cobre	Cobre	Cobre
Ib (A)	2.00	2.00	0.68	0.68	6.79	1.70
Potencia (kW)	1.04	1.04	0.31	0.31	4.00	1.00