



SERVICIO	P.GRUA	C.BIVALBA	P.DESARENADOR	V.EDIF.SOPLANTES	TORN.TRANSF.	B.AGUA BRUTA	TAMICES	TORN.COMP.	CLAS. ARENAS	SOPLANTES -DESAR.	SOPLANTES	SOPLANTES	VALVULAS-REGULAD.	ACELERADORES	B.CARGA CLORURO
P. NOMINAL (Kw)	5.50	4.00	2.05	0.250 (2)	0.75	2.40 (3)	1.50 (3)	1.10	1.10	1.50 (3)	18.50 (2)	18.5	1.10 (2)	1.50 (4)	1.10
I.NOMINAL (Amp.)	6.70	4.85	2.50	0.30	0.90	2.90	1.80	1.40	1.40	2.90	22.50	22.5	1.40	2.90	1.40
SECCION CABLES (mm ²)	4x2.50	4x2.50	4x2.50	4x2.50	4x2.50	4x2.50	4x2.50	4x2.50	4x2.50	4x2.50	4x10 3x10	4x10	4x2.50	4x2.50	4x2.50

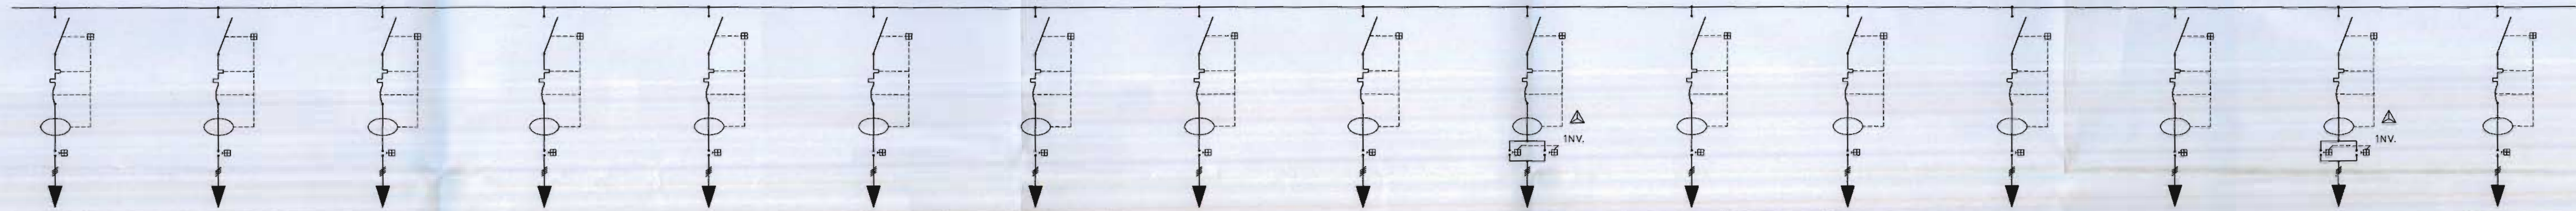

B.DOSIFICADORAS CLORURO	FLOCULADOR	CLARIFICADOR	B.FLOTANTES	B.RECIRCULACION	B.FANGOS EN EXCESO	GRP.PRESION	ESPESADOR DE FANGOS	B.FANGOS ESPESADOS	MOTOR CENTRIFUGA	TORNILLO	DOSIFICADOR	AGITADORES POLIELECTROLITO	B.DOSIFICADORAS POLIELECTROLITO	VENTILADOR DESODORIZACION	COMPRESOR
0.90 (2)	0.18	0.55 (2)	1.30	1.30 (3)	1.30 (2)	4.00	0.25	0.75 (2)	18.50	1.50	0.25	0.37 (2)	0.37 (2)	5.00	3.00
0.10	0.20	0.67	1.60	1.60	1.60	4.85	0.30	0.90	22.50	2.90	0.30	0.45	0.45	13.40	3.65
4x2.50	4x2.50	4x2.50	4x2.50	4x2.50	4x2.50	4x4	4x2.50	4x2.50	4x10 3x10	4x2.50	4x2.50	4x2.50	4x2.50	4x4 3x4	4x2.50

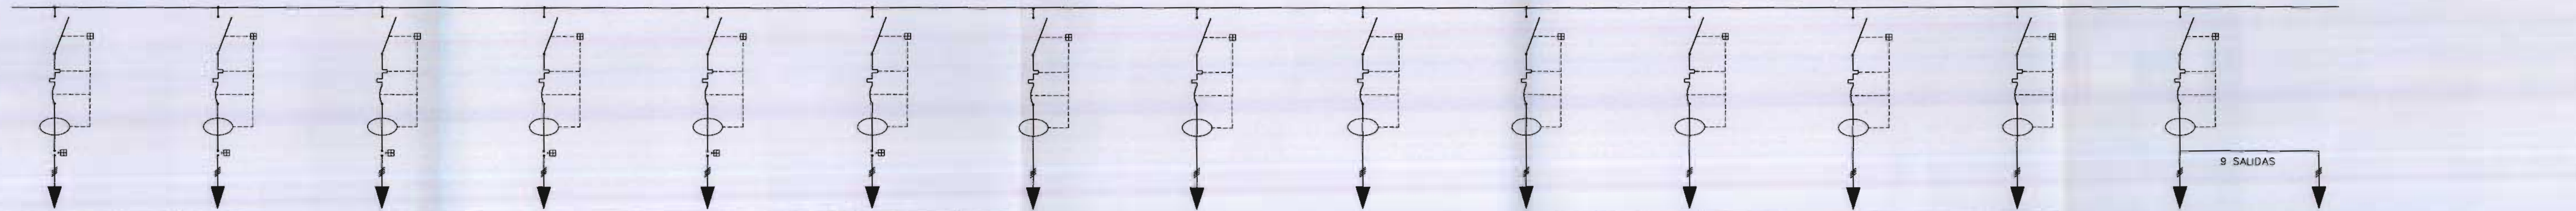

SECADOR	B.VACIADOS	E.VALVULAS GRASAS	E.VALVULAS FLOTANTES	C.CONTROL CENTRIFUGA	B.DOSIFICADORA REACTIVOS	CONTROL	LABORATORIO	TALLER	TOMAS FUERZA	ALUMBRADO INTERIOR	ALUMBRADO EXTERIOR	AIRE ACONDICIONADO CALEFACION	INTRUMENTACION
0.55	3.40 (2)	0.018 (2)	0.018 (2)	0.200	0.09	3.00	5.00	10.00	5.50	15.00	10.00	6.00	
0.67	4.15	0.08	0.08	0.90	0.04	3.65	6.10	12.15	6.70	18.25	12.15	7.00	
4x2.50	4x2.50	2x1.50	2x1.50	2x1.50	2x1.50	4x2.50	4x2.50	4x4	4x2.50	4x4	4x6	4x2.50	

Consejería de
Obras públicas

Junta de Comunidades de
Castilla-La Mancha

CLAVE
HD-GU-99-5230M
ESCALA
s/e
FECHA
ENERO 2003

TITULO
**PROYECTO MODIFICADO Nº1
DE LAS OBRAS Y EXPLOTACION Y MANTENIMIENTO
DE LA E.D.A.R. DE MOLINA DE ARAGON (GUADALAJARA)**

PLANO
ESQUEMA ELECTRICO

Nº DE PLANO
EE-02